




1325 Furneaux Road, Plumas Lakes, CA. 95961
 (530) 742-9675
 www.placerwaterworks.com

6" (6 PORTS) FIRE DEPARTMENT CONNECTION PW/FDC-6206 STRAIGHT

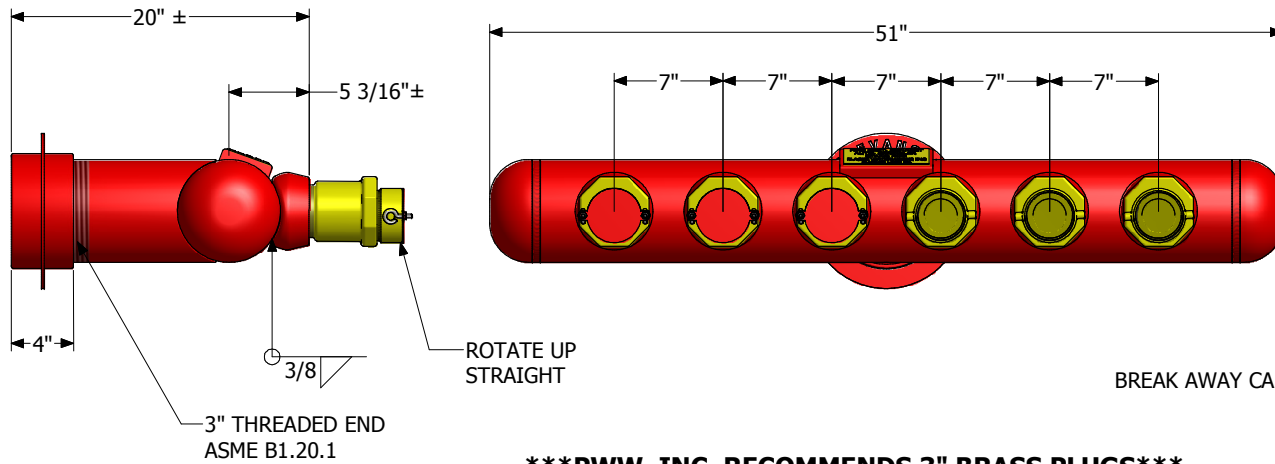



*****PWW, INC. RECOMMENDS 3" BRASS PLUGS*****

NOTES:

1. ALL HORIZONTAL PIPE IS 6" A-53, SCHEDULE 40 BLACK TYPE.
2. 3" WELD-O-LETS WELDED ON 7" CENTERS WITH FIRST - A ROOT PASS. SECOND, FILLET PASS. FINISH WITH A 3/8" FINAL PASS.
3. PIPE CAPS AND PIPE TO PIPE CONNECTION TO BE 100% PENETRATION.
4. WELDING TYPE: SEMI-AUTOMATIC NR 211 INNER SHIELD WIRE PER SECTION 9 ASME CODE.
5. 6" SCH.40 STEEL PIPE 3" THREADED END (THREADS CONFORM TO ASME B1.20.1)
6. ABOVE UL INFORMATION IS FOR "3" BRASS SNOOT CONNECTION" [MALE CHECK SNOOT] ONLY
7. BRASS CLAPPER SNOOT'S TO HAVE BRASS PLATED FINISH
8. ENTIRE FIXTURE IS ABRASIVE BLASTED SSPC SP-5 WHITE METAL BLAST 2-3 MIL ANGULAR PROFILE THEN POWDER COATED RED W/ 4-6 MILS FILM THICKNESS.
9. ALL WELDING DONE PER AWS D1.1 SECTION 3 FCAW PROCESS.
10. 6" NPT COUPLING TO BE ASTM A865
11. FDC TO HAVE 3/16" THK. X 10" DIA. NAME PLATE & POWDER COATED
12. NOT RECOMMENDED FOR WET SYSTEM.

CAT#: PW/ FDC-6206 STRAIGHT: 6" (6 Ports) Fire Department Connection


Copyrighted 2013 Placer Waterworks, Inc. © All Right Reserved - For Duplication Authorization may obtain thru: kkern@placerwaterworks.com

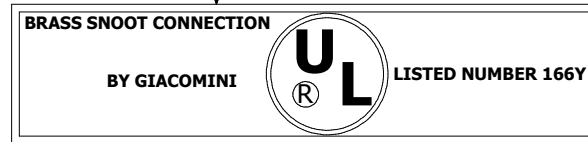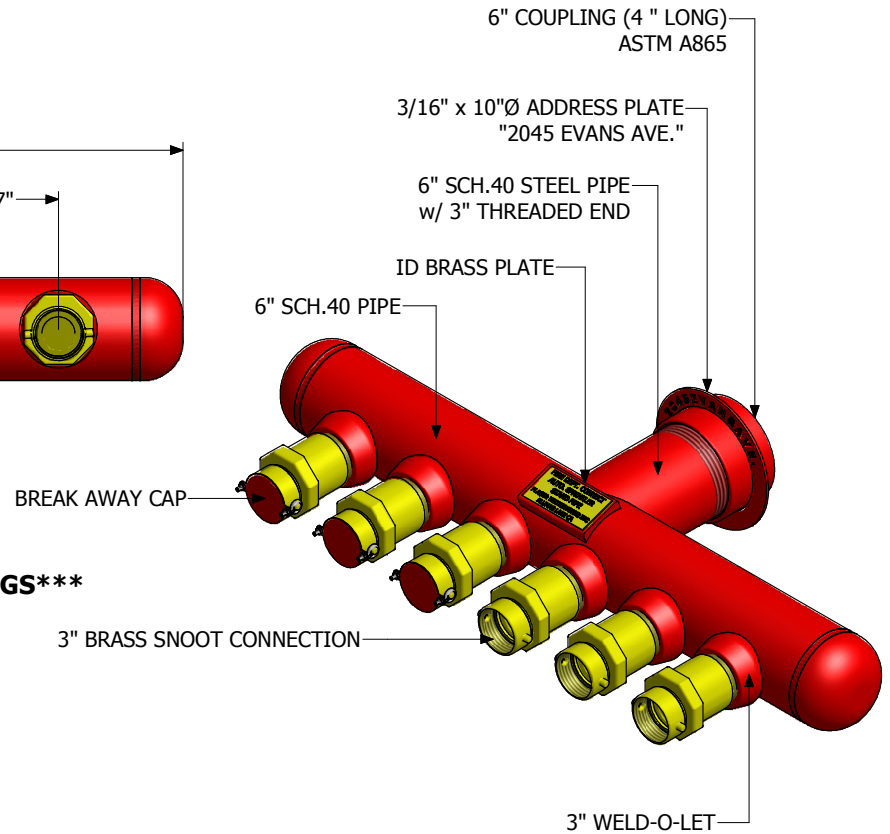




Fabricator of Infrastructure Parts and Accessories
 1325 Furneaux Road, Plumas Lakes, CA. 95961
 (530) 742-9675
 www.placerwaterworks.com

6" (6 PORTS) FIRE DEPARTMENT CONNECTION PW/FDC-6206 STRAIGHT

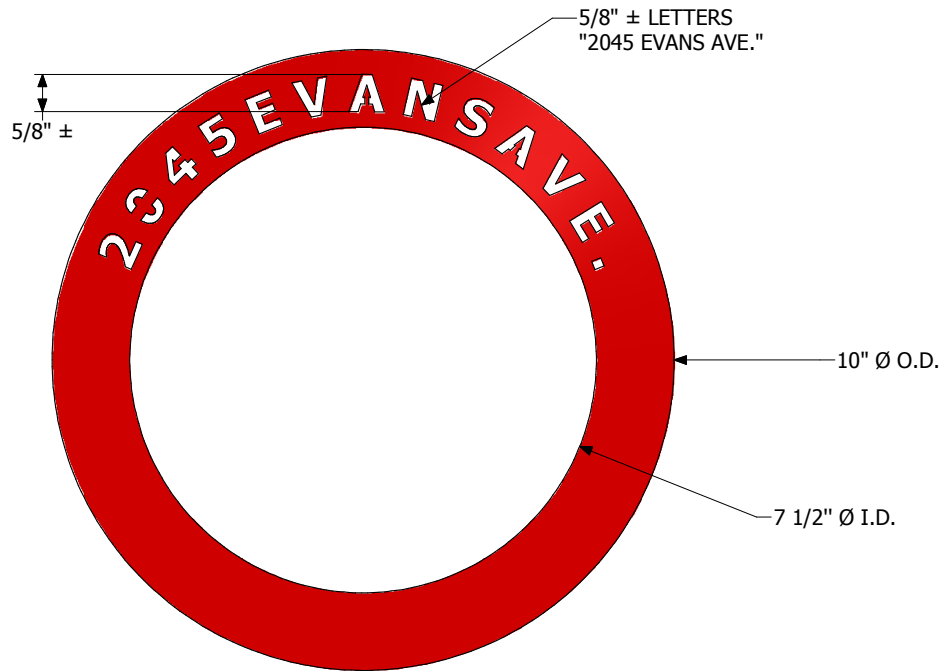

3/16" THICK NAME PLATE
 (NOTE: TO BE POWDER COATED)

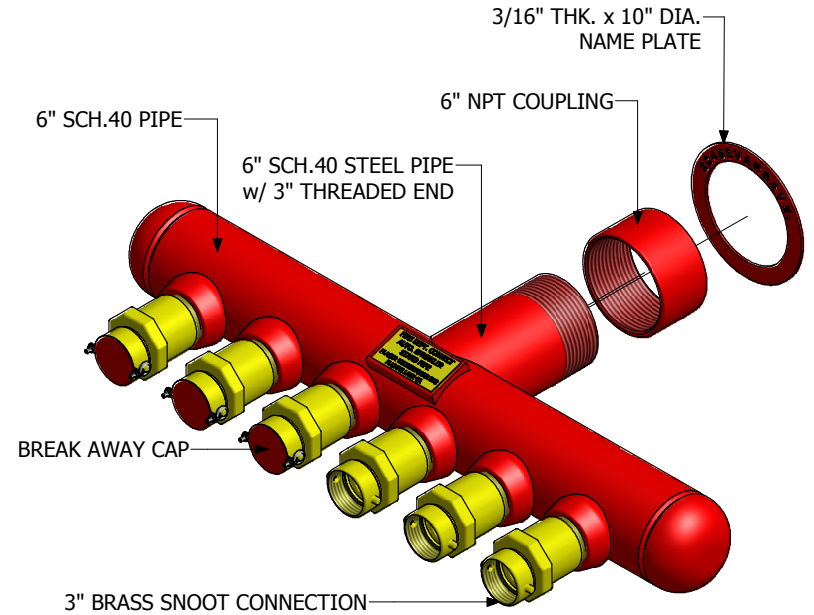

*****PW, INC. RECOMMENDS 3" BRASS PLUGS*****